



GUANGZHOU ZHIGUANG ELECTRIC TECHN

2 0 2 1





1999



2007

002169

“

”

20

“

+

+

”



2002 2
002169


PCS


UPS

SVG

/

“ + ”

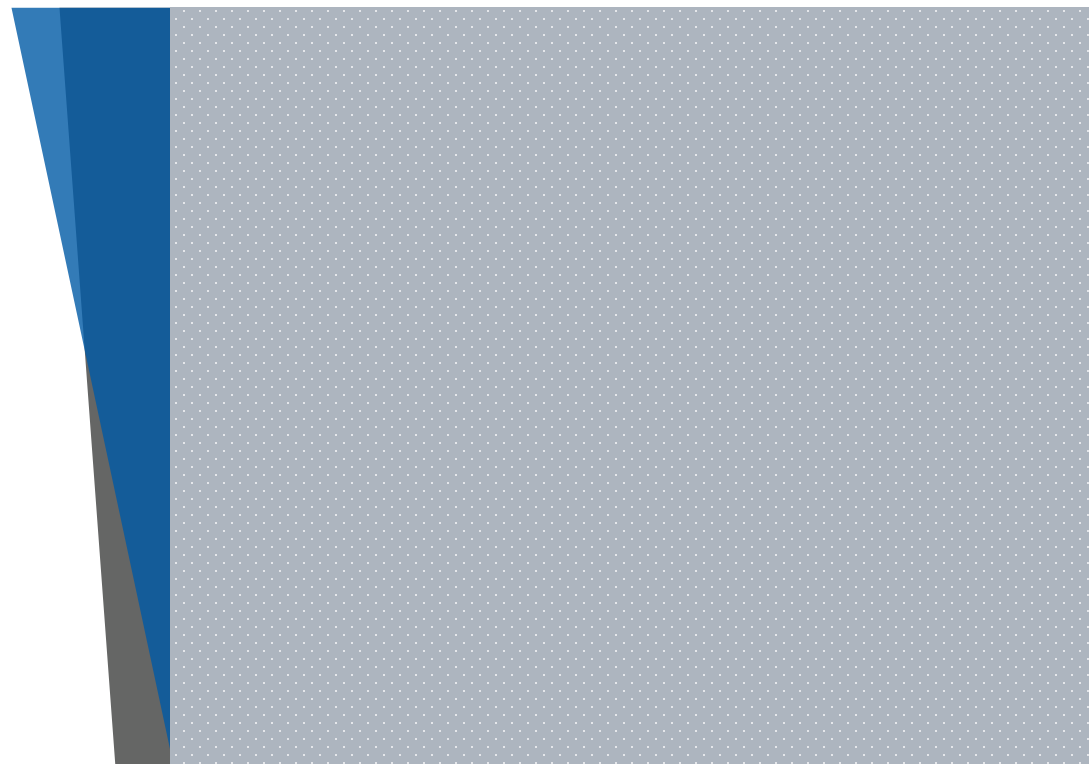

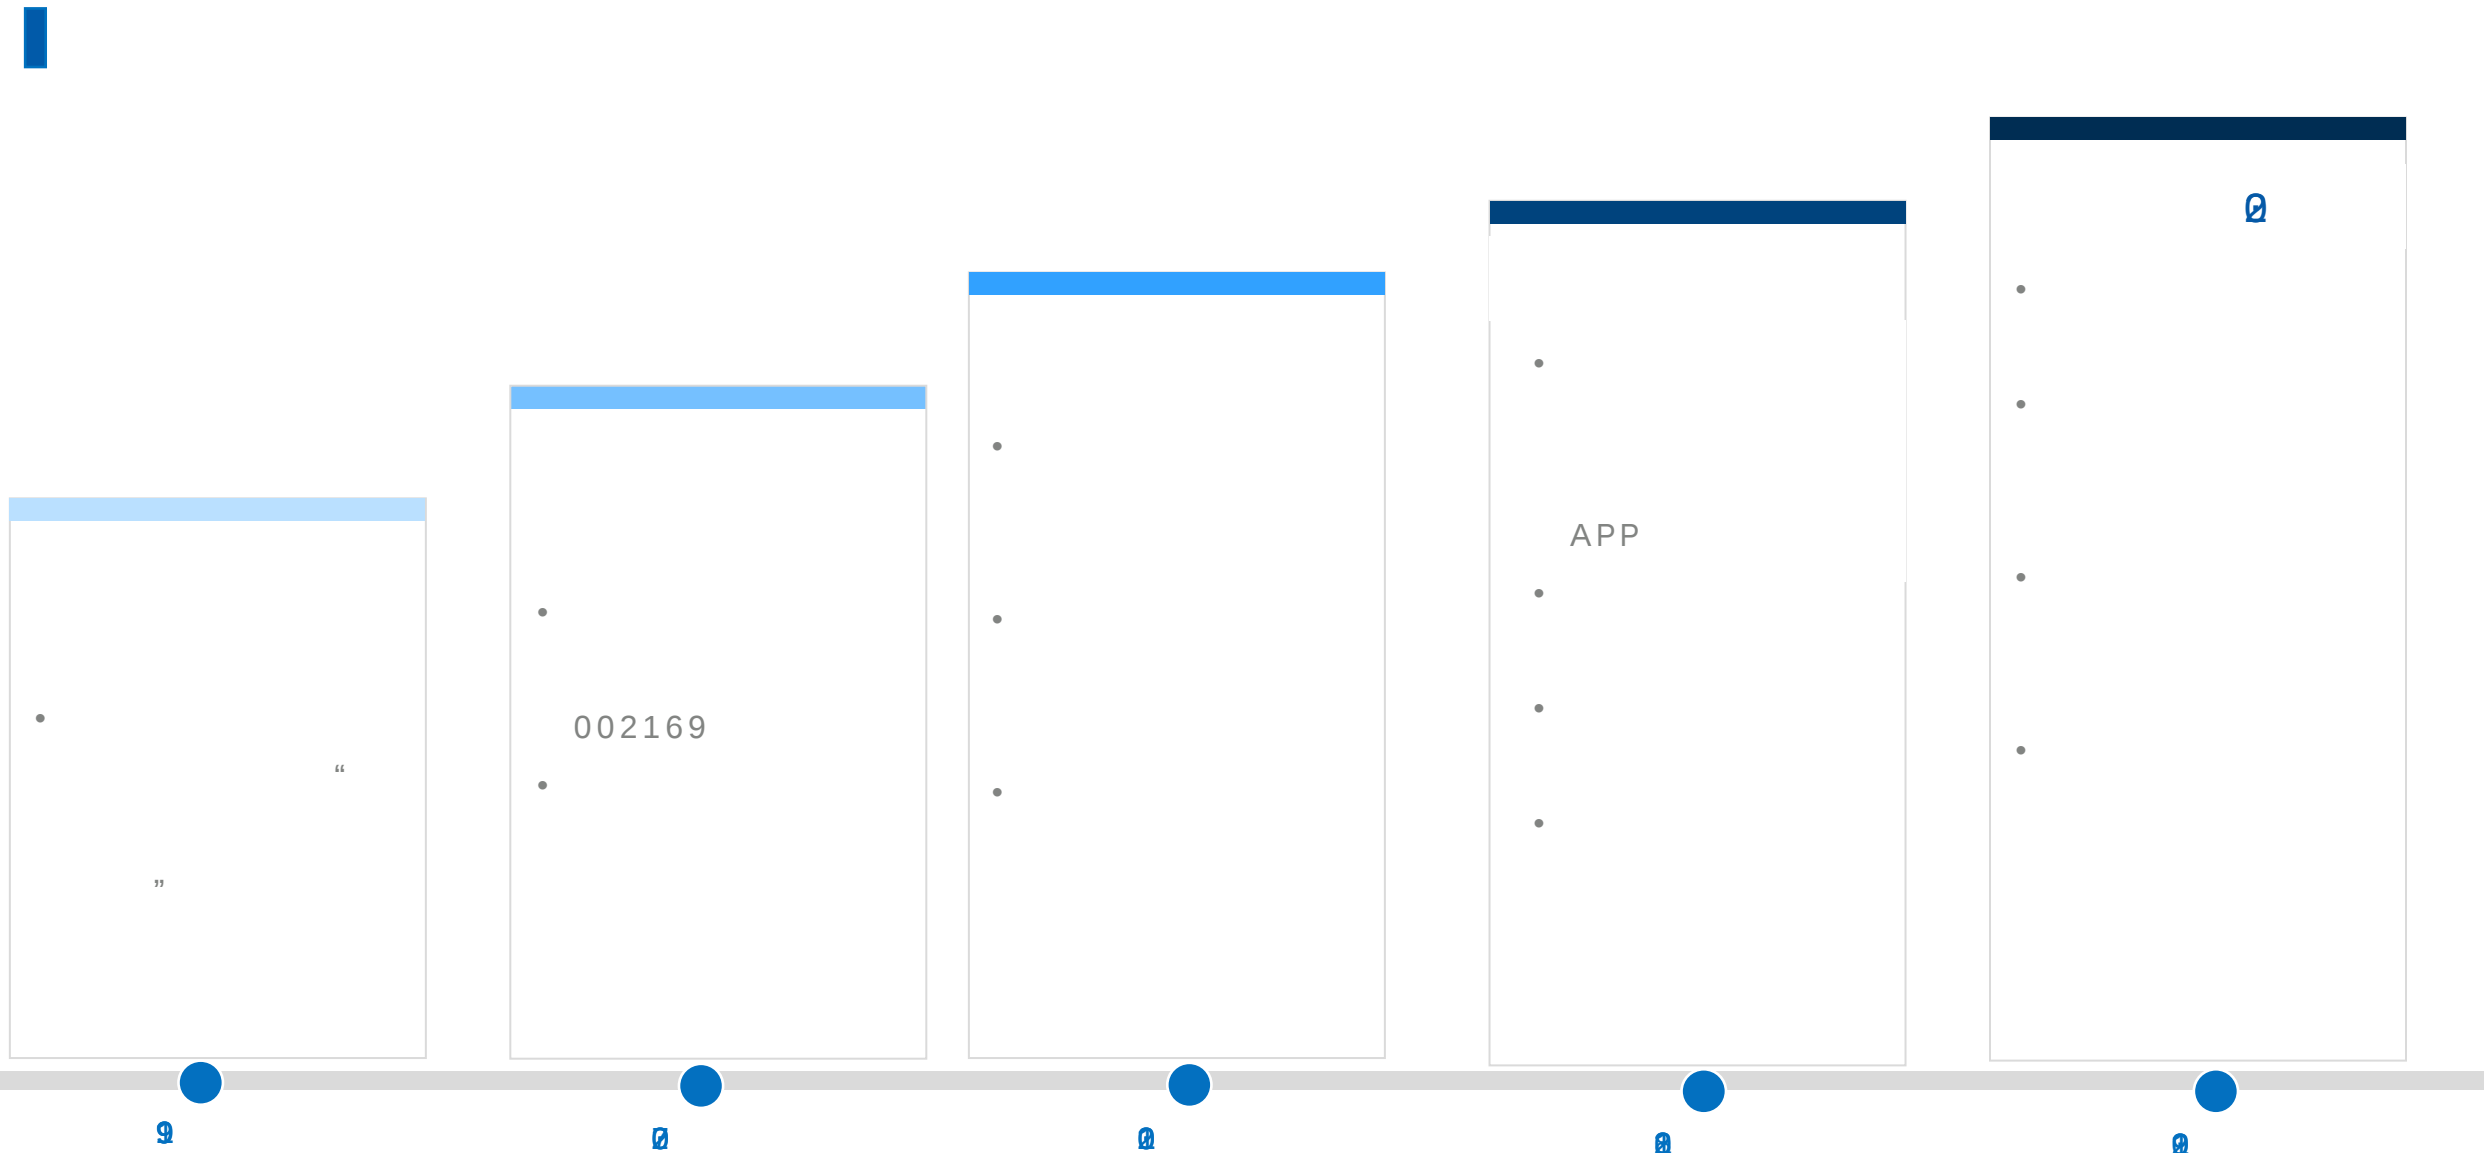

-
-

-
-
-

-
-

UPS


-
-
-

SVG

-
-
-

PACK BMS PCS EMS


-
-
-
-

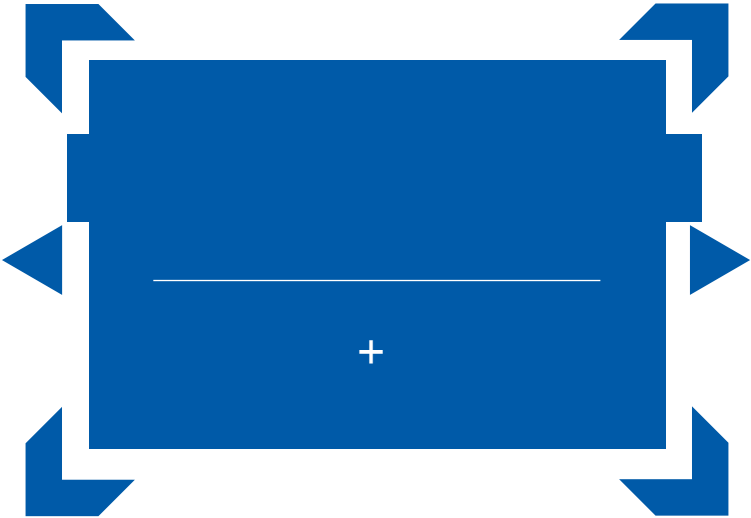





3000

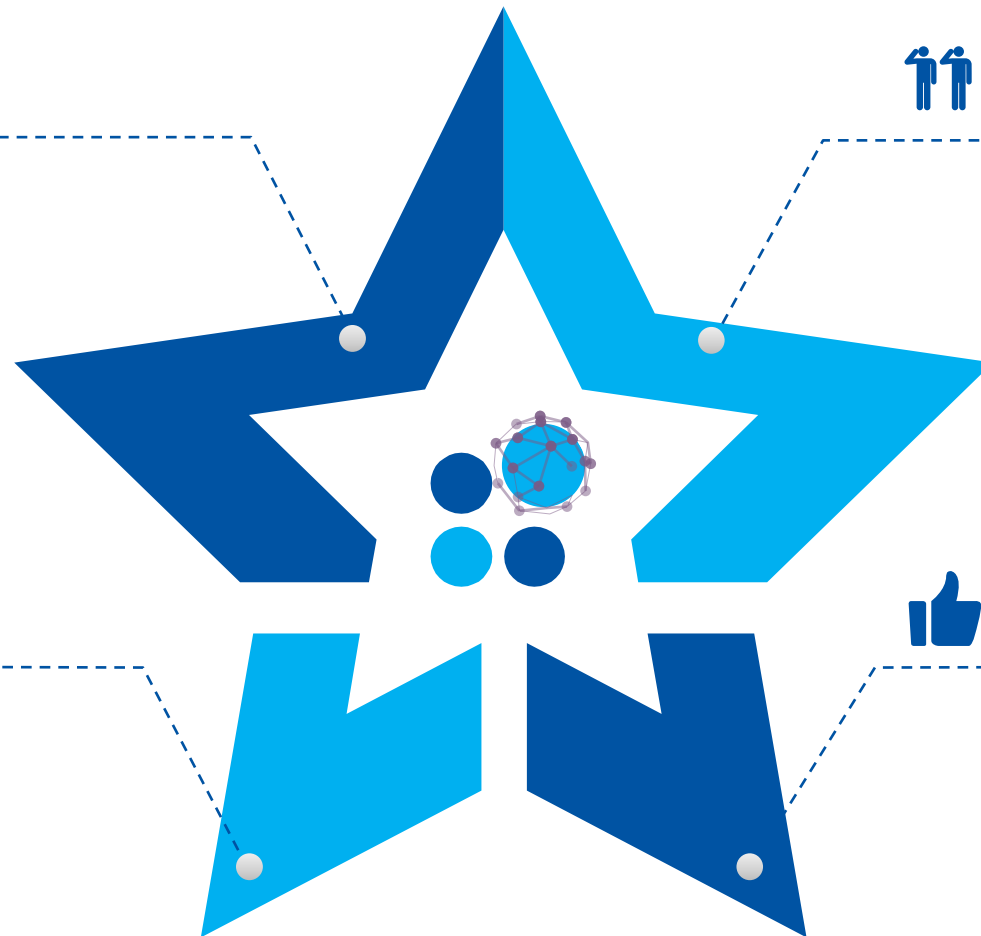



- 2009
- 2012
- 2013
- 2014
- 2017
- 2018
- 2018
- 2019
-
-
- 2019



2021 7 1

450

333


333 ;



40



6-35kV





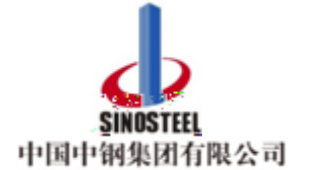

Integrated Energy Services

电网场景

Power grid scenario

新能源
场景

New energy scene

工业场景

Industrial scene

储能场景

Energy storage
scenario

交通场景

Traffic scene

典型应用场景

TYPICAL APPLICATION SCENARIOS



“


“



7000kVA~30000kVA

300MW—600MW

600MW

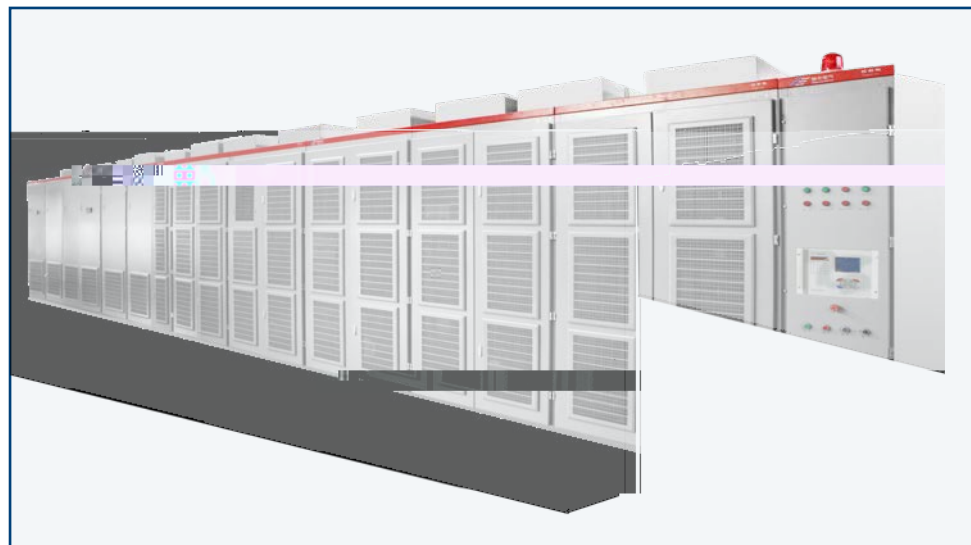

2x7800kW



2x6300kW



ZG-SPS

ZG-SPS

0.4kV~35kV





3~10kV

1000MW




()

()

(5MW)

6-35kV

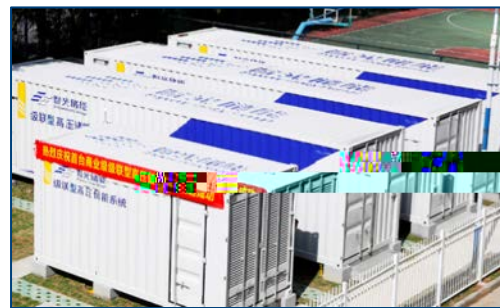



(

35kV 600V 400V

8

(UPS)

(

AFC

UPS

)

UPS

110

UPS

UPS

UPS



1 2 3



5





KD-XH

78%


260

(333)



10000

2008
 IEC61850(DL/T860)

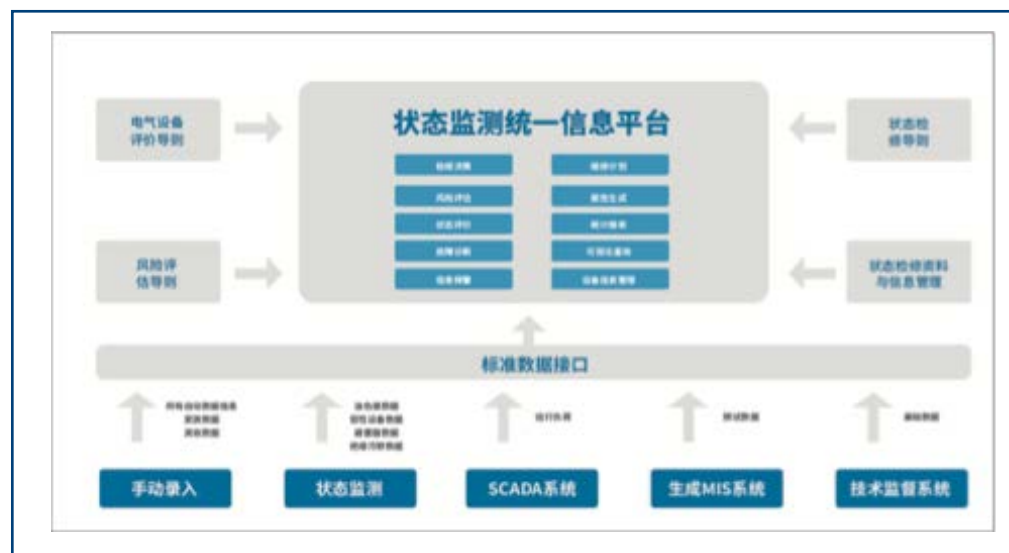



ZG-dSVG

0.4kV~35kV

50MVar(
)



SVG



SVG



ZG-dSVC

ZG-dSVC





() ()

(SVG/SVC)

()

(APF)



ZG-PSVG
ZG-SVG





ZG-dPQC



“

”


“

”

“

”

“主 图

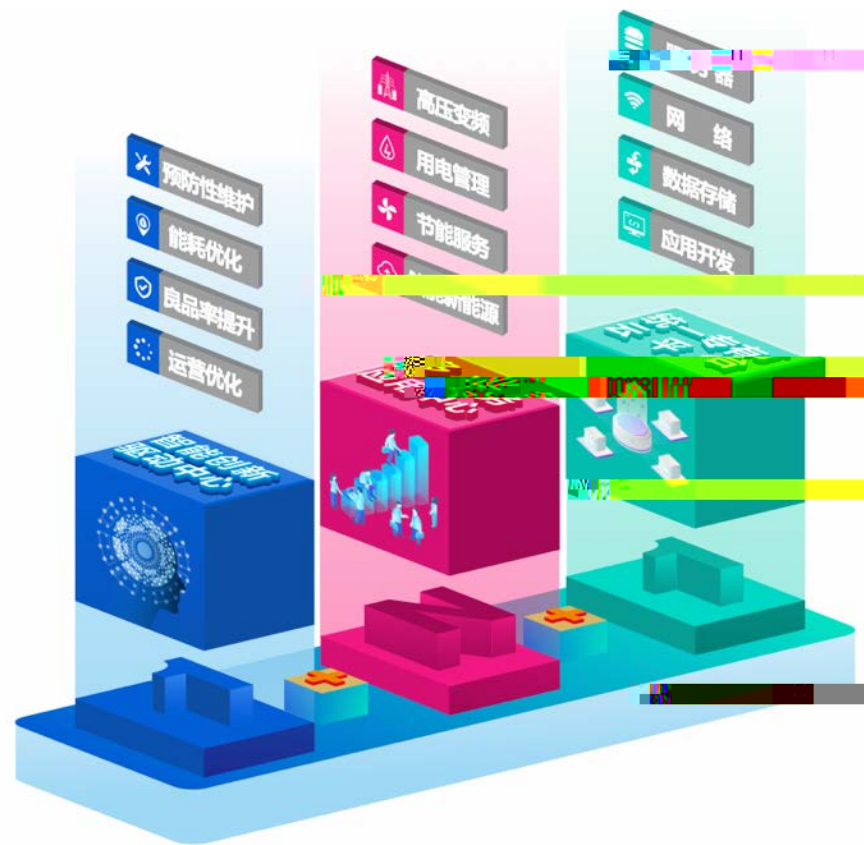

Thanks for Your Time